

Report of completed program


Campaign No: No: 037- DISCOMS, Gujarat

Date & Time: 23 October 2021: 02.30 PM to 04.30 PM

Subjects of training: System earthing and equipment earthing in Low voltage Electrical installation including supply transformer(Part 2): Protective earthing, Interpretation of IS 732 / IS 3043 and the CEA safety regulation draft 2021, Over voltage and relation to earthing and the methods to prevent it, Functional earthing for electronics

Participation Details: Engineers from Electrical inspectorate, Govt of Gujarat, No of participants – 489

Feedback

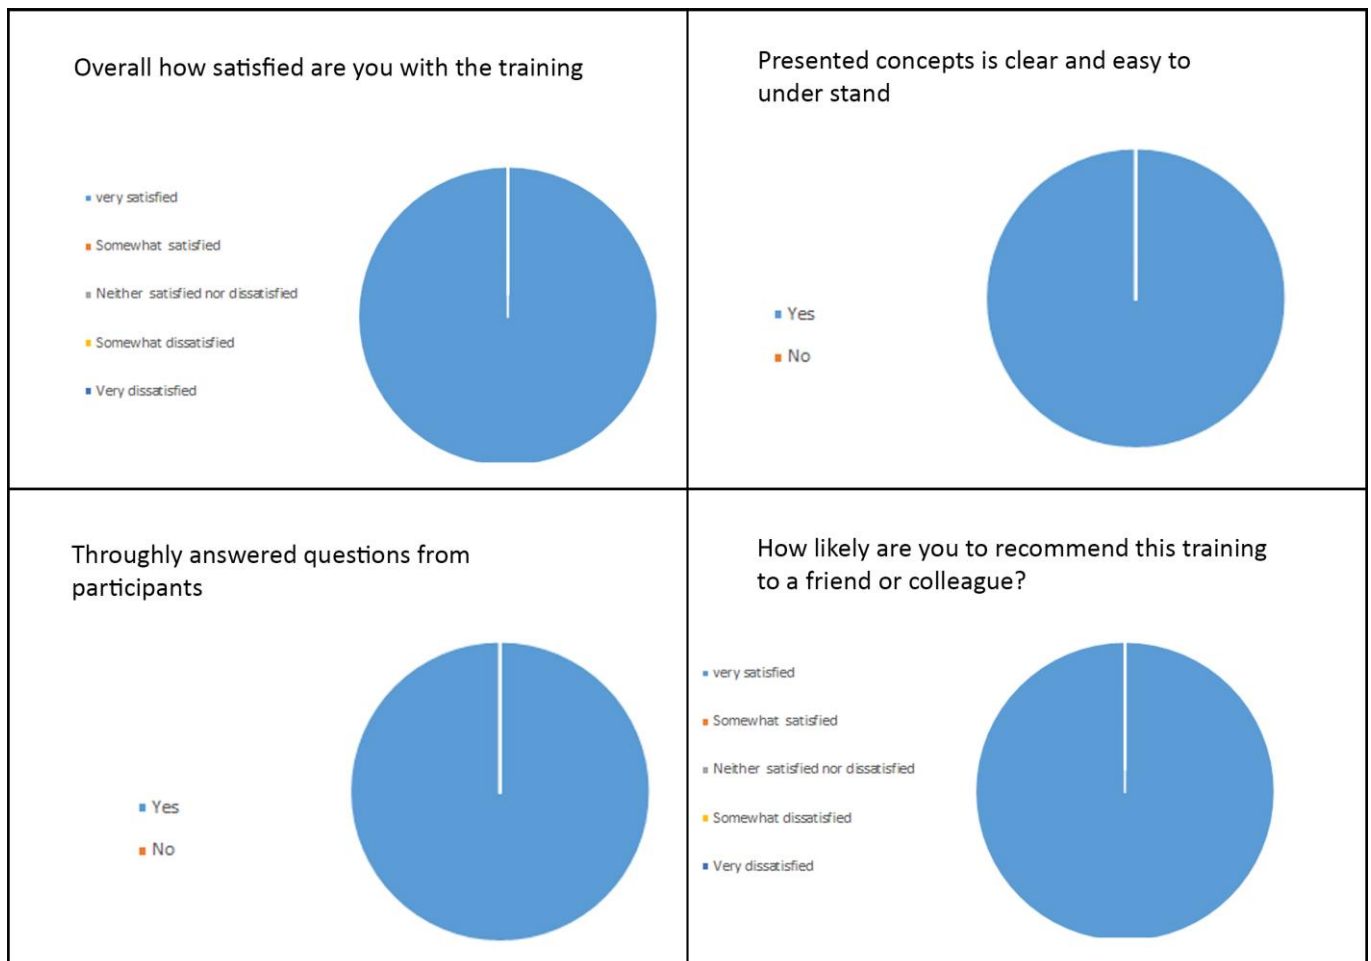

Organized by

Centre for Innovation in Science and Social Action (CISSA)

T.C. 15/510, USRA 55, Udarasiromani Road,

Vellayambalam, Thiruvananthapuram, Kerala – 695010, India

E-mail : info@vidyutsuraksha.com Web: www.vidyutsuraksha.com

Technical Questions & Comments

1. Explain Sizing of the interlink between two earth electrodes.

General Comments about the subject and content of the training

1. Excellent session for better knowledge and upgradation and As this type session should be repeated

Speaker

S Gopa kumar, Program & Technical Coordinator, Vidyut Surakshit Bharat Abhiyan

Note: Videos of training are available to participants upon request

Contact

Arunkumar: Program coordinator

Mob:9342937518

E mail: info@vidyutsuraksha.com

Vidyut Surakshit Bharat Abhiyan

C/O Centre for Innovation in Science and Social Action (CISSA)

T.C. 15/510, USRA 55, Udarasiromani Road,

Vellayambalam, Thiruvananthapuram,

Kerala – 695010, India

Organized by

Centre for Innovation in Science and Social Action (CISSA)

T.C. 15/510, USRA 55, Udarasiromani Road,

Vellayambalam, Thiruvananthapuram, Kerala – 695010, India

E-mail : info@vidyutsuraksha.com Web: www.vidyutsuraksha.com