


Report of completed program

Campaign No:	No:011 - Day 1 of series of 4 programs
Date & Time:	31 July 2021: 02.30 PM to 04.30 PM
Subjects of training:	System earthing and equipment earthing in Low voltage Electrical installation including supply transformer(Part 2): Protective earthing, Interpretation of IS 732 / IS 3043 and the CEA safety regulation draft 2021, Over voltage and relation to earthing and the methods to prevent it, Functional earthing for electronics
Participation Details:	Engineers from Electrical inspectorate, Govt of Tamilnadu, No of participants – 21

Feedback

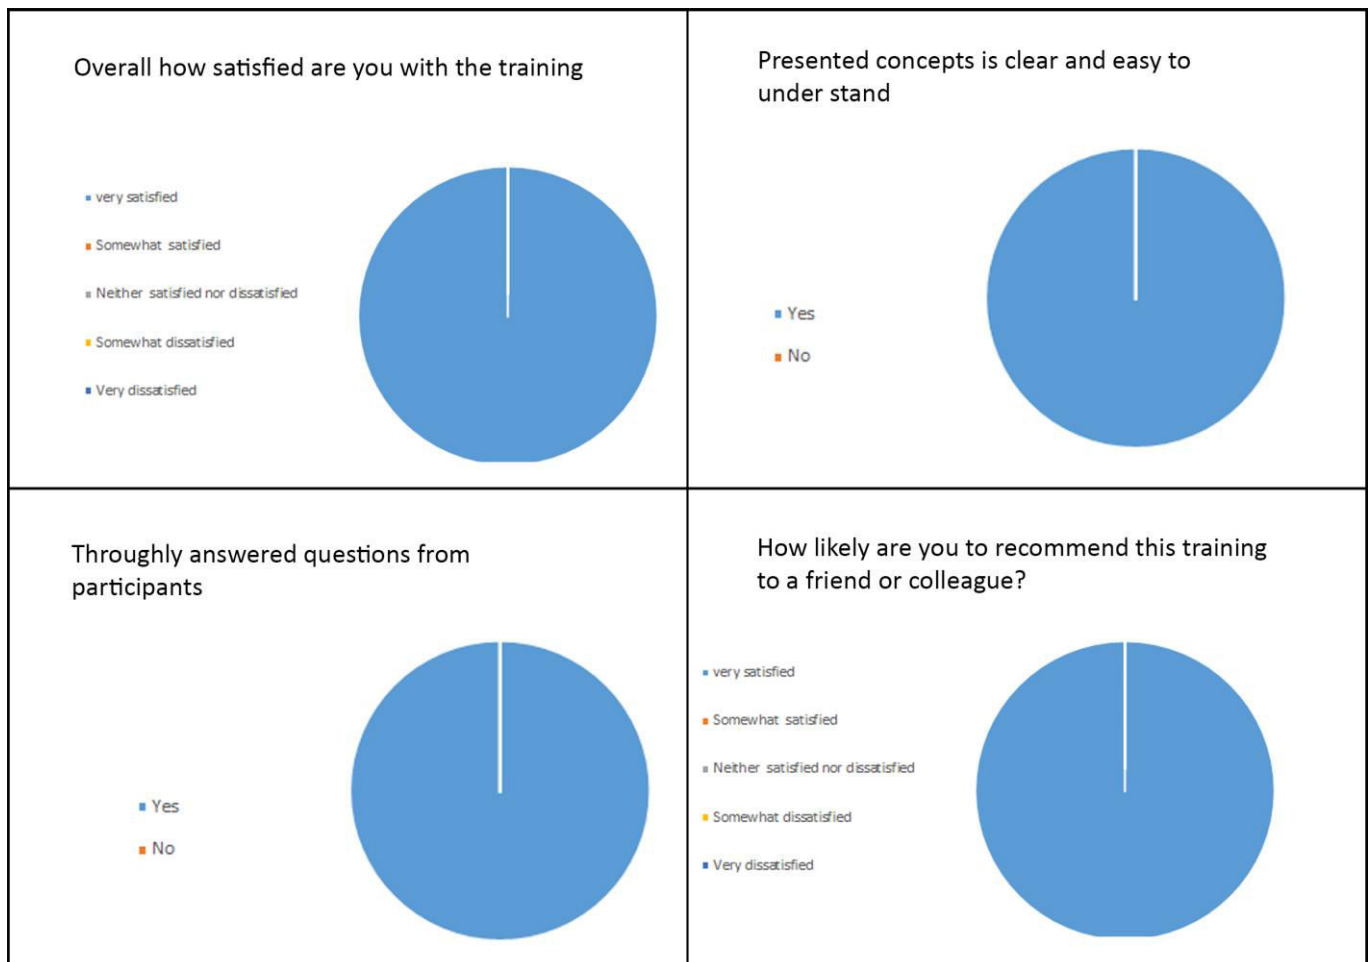

Technical Questions & Comments

1. Explain Sizing of the interlink between two earth electrodes.

General Comments about the subject and content of the training

1. very useful program. Thanks for arranging. Great effort
2. It is an excellent program. Is 732 and IS 3043 are explained in a very beautiful manner.

Speaker

S Gopa kumar, Program & Technical Coordinator, Vidyut Surakshit Bharat Abhiyan

Note: Videos of training are available to participants upon request

Contact

Arunkumar: Program coordinator

Mob:9342937518

E mail: info@vidyutsuraksha.com

Vidyut Surakshit Bharat Abhiyan

C/O Centre for Innovation in Science and Social Action (CISSA)

T.C. 15/510, USRA 55, Udarasiromani Road,

Vellayambalam, Thiruvananthapuram,

Kerala – 695010, India